


# Wessex Water Network Map

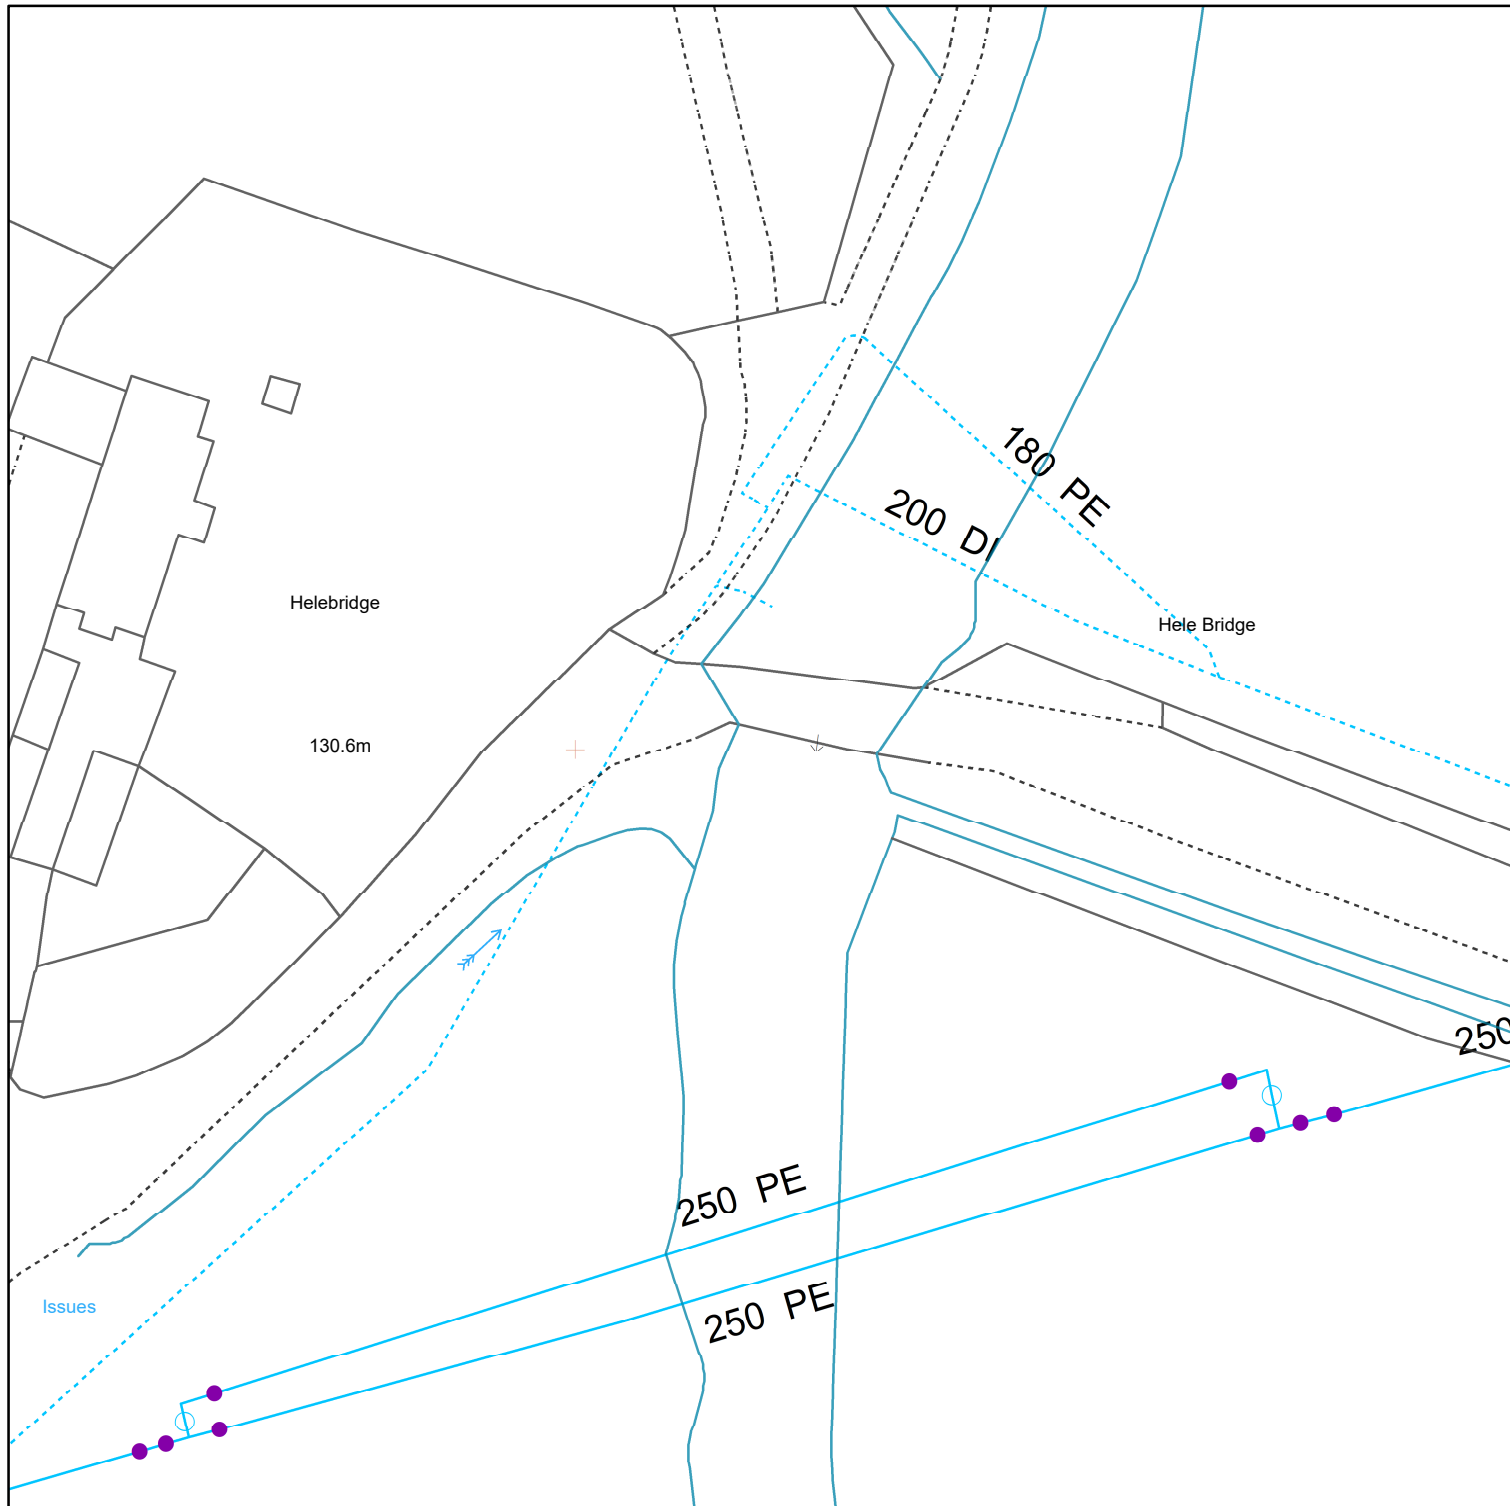

Reproduced from the Ordnance Survey map by permission on behalf of the Controller of Her Majesty's Stationery Office © Crown Copyright . Licence 100019539.

WATER MAINS		SEWERS		STRATEGIC		PUBLIC		PRIVATE		SECTION 104		OTHER WESSEX PIPES		NON-WESSEX / UNKNOWN	
	Distribution		Foul										Rising Mains		Private Rising Mains
	Washout		Surface										EDM Effluent Disposal		Culverted Watercourse
	Raw Water		Combined										Overflow		Highway Drain
	Abandoned		Abandoned										Syphon		Use Unknown
	Private														Status Unknown
		Colours generally indicate the use of the sewer/drain (i.e Red - Foul, Dark Blue - Surface, Magenta - Combined/Dual Use, Light Green - Highway Drain, Mid Green - Overflow).													
		Some styles of line and symbol are shown on the key in sample/typical colours.													
<b>FITTINGS</b>		<b>STRUCTURES</b>													
	Hydrant		Manhole - Foul		Pumping Station - Surface										
	Other		Manhole - Surface		Pumping Stn - Foul/Combined										
			Manhole - Combined		Gully										
			Inlet		Vent Column										
			Outfall		Rodding Eye										
			Lamphole		Catchpit										
			Bifurcation - Foul		Flushing Chamber										
			Bifurcation - Surface		Soakaway										
			Bifurcation - Combined		Non Return Valve										
			Combined Sewage Overflow		Air Valve		Hatch Box		Washout						
				<b>OTHER STRUCTURES</b>											
					Attenuation Tank		Tunnel								
					Storage Tank		Interceptor								
<div> </div>															

Information in this map is provided for identification purposes only. No warranty as to accuracy is given or implied. The precise route of pipe work may not exactly match that shown. Wessex Water does not accept liability for inaccuracies. Sewers and lateral drains adopted by Wessex Water under the Water Industry (Schemes for Adoption of Private Sewers) Regulations 2011 are to be plotted over time and may not yet be shown. In carrying out any works, you accept liability for the cost of any repairs to Wessex Water apparatus damaged as a result of your works. You are advised to commence excavations using hand tools only. Mechanical digging equipment should not be used until pipe work has been precisely located. If you are considering any form of building works and pipe work is shown within the boundary of your property or a property to be purchased (or very close by) a surveyor should plot its exact position prior to commencing works or purchase. If you are proposing to build over or near Wessex Water's apparatus you should contact the Developer Services Team, tel: 01225 526633 or e-mail: [developer.enquiries@wessexwater.co.uk](mailto:developer.enquiries@wessexwater.co.uk) to discuss your proposals. Details of assets within Wessex Water's land ownership are unavailable through this service.

**OTHER STRUCTURES**

	Attenuation Tank		Tunnel
	Storage Tank		Interceptor

**Wessex Water**  
YTL GROUP



**Date:** 14/09/2021  
**Centre:** 293304, 127826  
**Scale:** 1:625  
(when printed at A4 size)

